# Wall Section, Cantilevered Bay Window

D1.18
Dec. 5, 2011

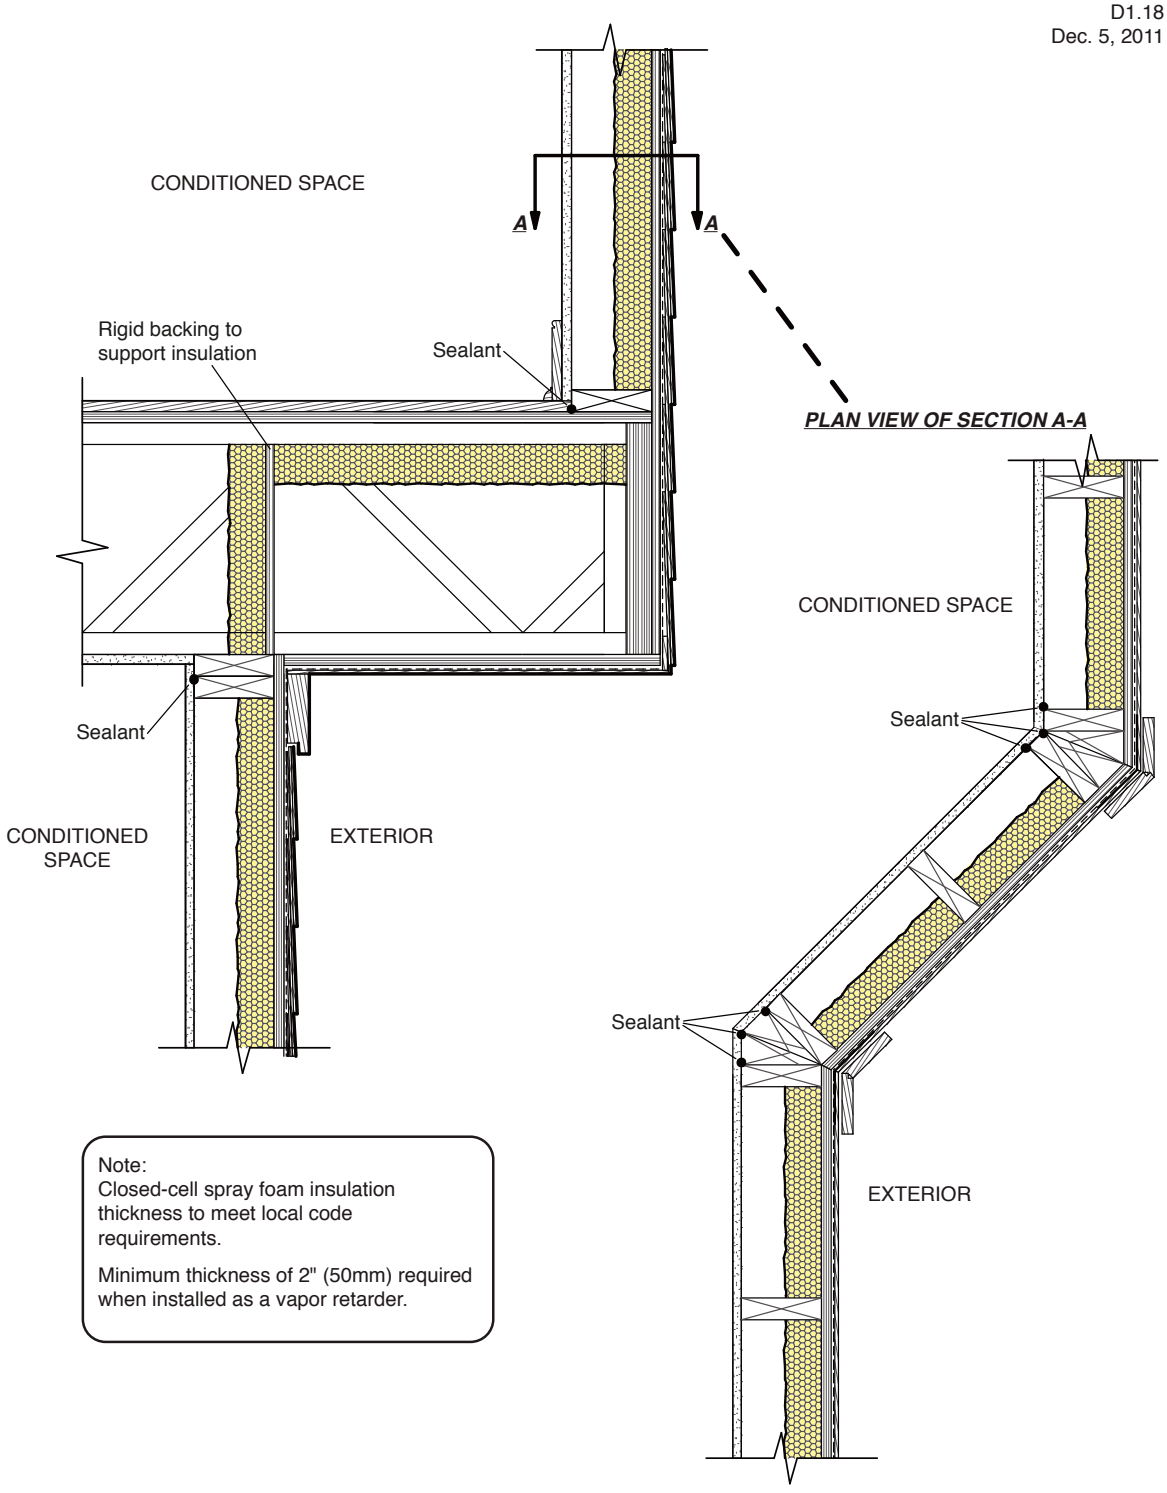


Note:
Closed-cell spray foam insulation thickness to meet local code requirements.

Minimum thickness of 2" (50mm) required when installed as a vapor retarder.

Insulthane a Division of Elastochem
37 Easton Rd Brantford, On N3P 1J4, Canada
www.Elastochem-ca.com/insulthane